


General Permit Requirements for Stormwater Discharges from Water Utilities and Fire Control Systems¹

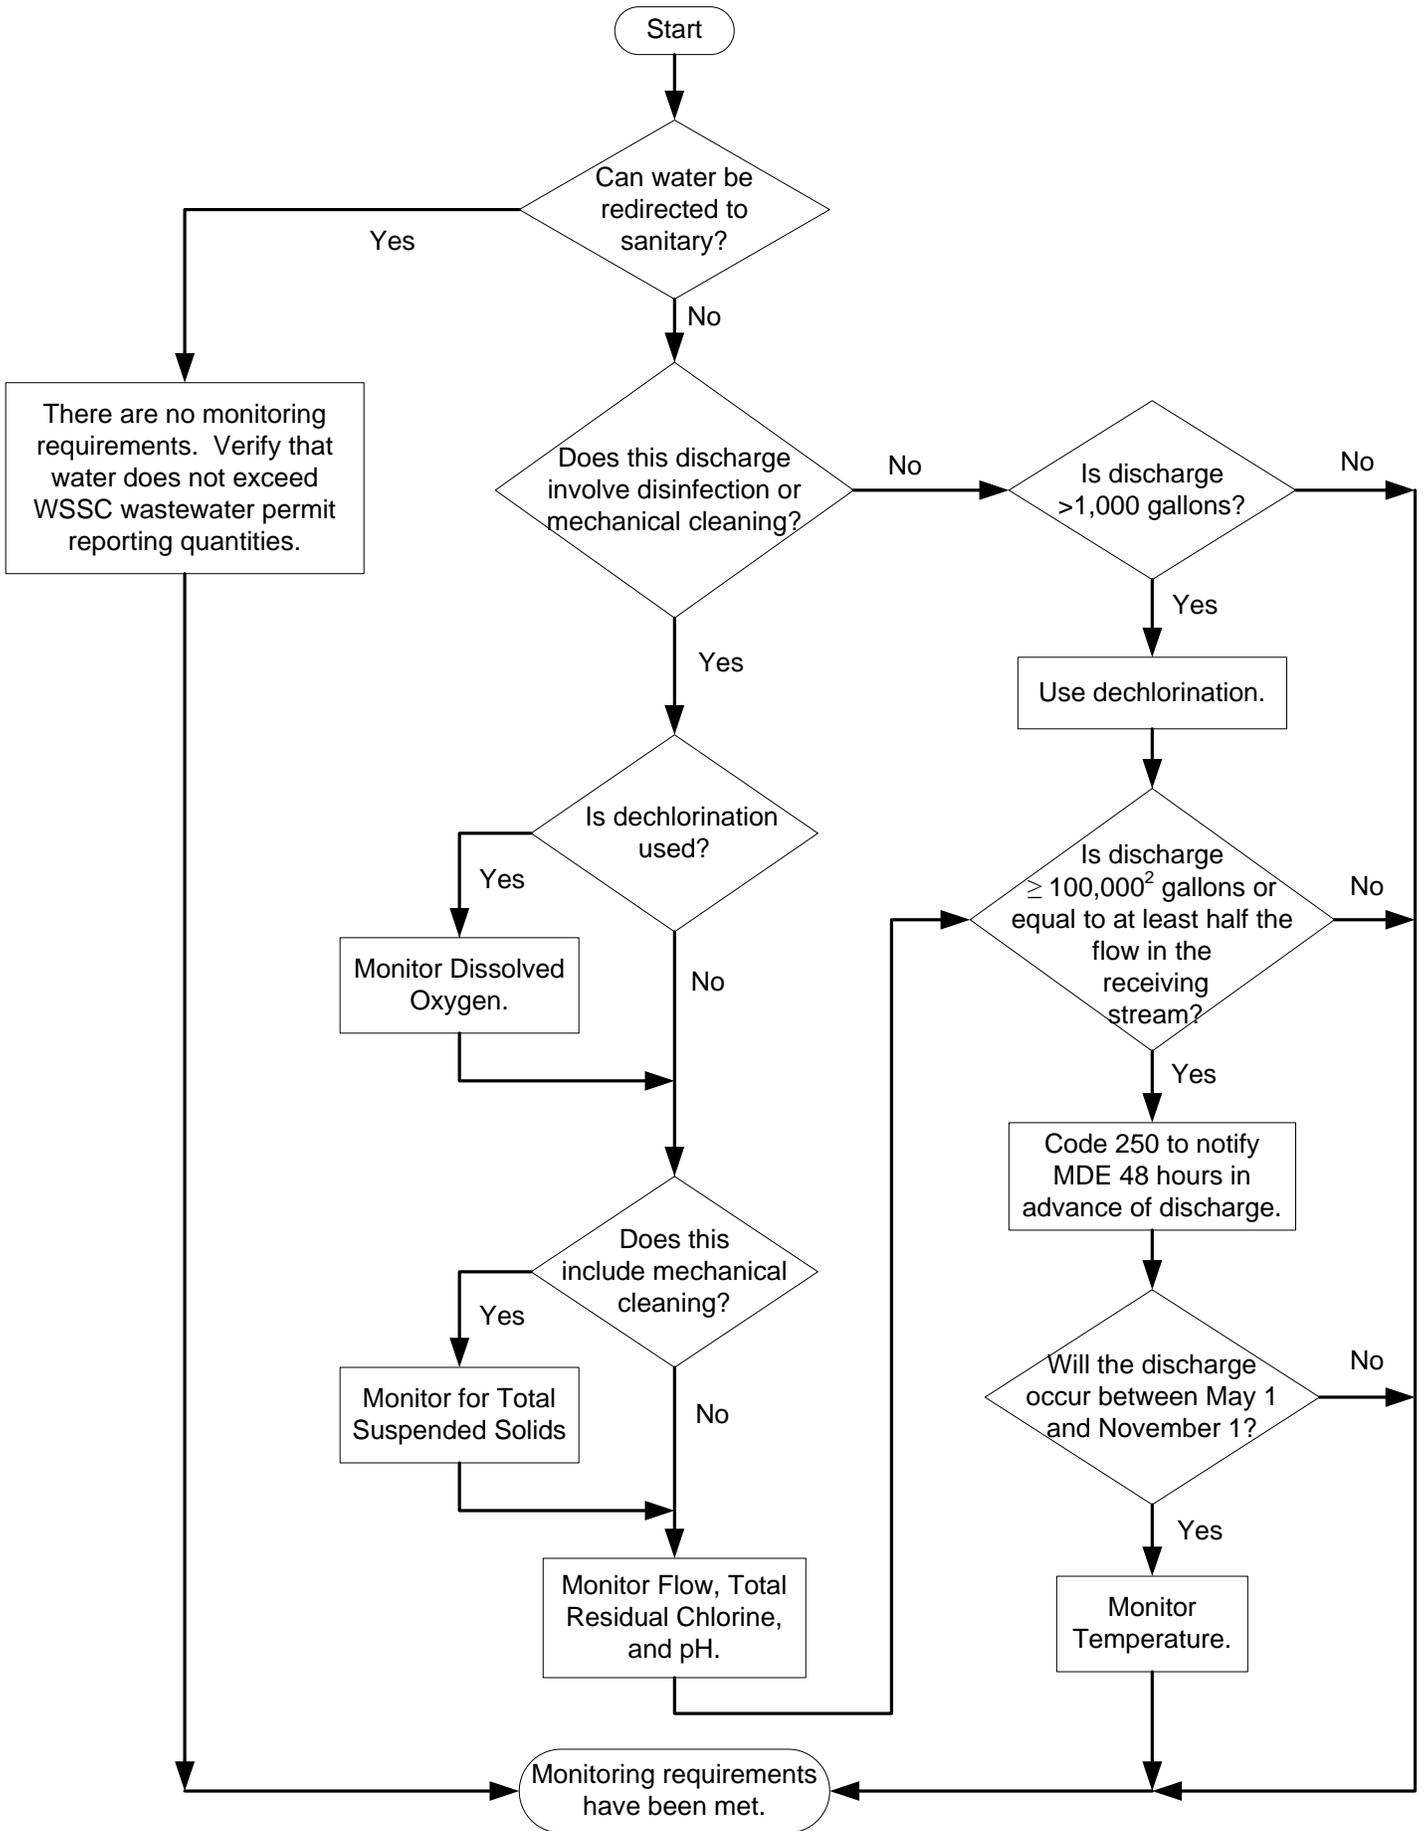

¹Contact Code 250 for assistance or more information about the monitoring and reporting requirements, notification, and record keeping.

²A permit modification will be required. NOI must be filed at least 60 days in advance.